


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

DATA OF LAMP		PHOTOMETRIC DATA Eff: 162.24 lm/W			
MODEL		Imax (cd)	1222	S/MH(C0/180)	1.14
NOMINAL POWER(W)	21	LOR(%)	100.0	S/MH(C90/270)	1.27
RATED VOLTAGE(V)	120	TOTAL FLUX(lm)	3521.7	η UP,DN(C0-180)	0.0,49.6
NOMINAL FLUX(lm)	3521.68	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.4
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	1.25
TEST VOLTAGE(V)	120	η down (%)	100.0	CIBSE SHR MAX	1.35

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

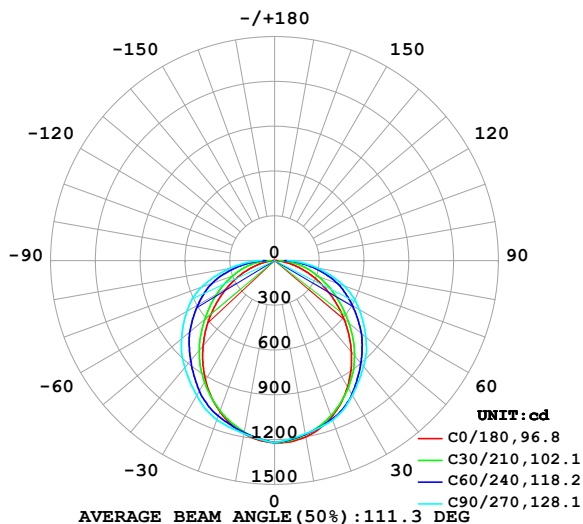

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

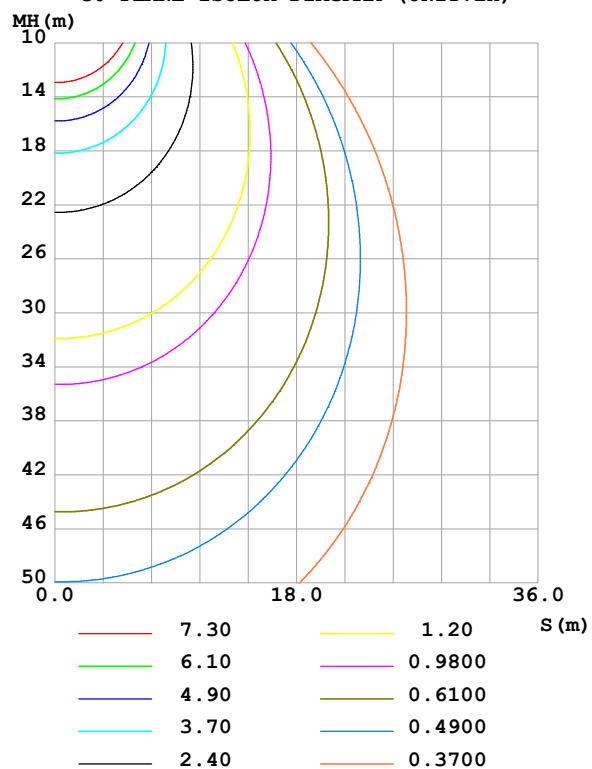

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3 °C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1200	1183	1179	1168	1178	1167	1178	1182	0- 10	114.1	114.1	3.24,3.24
20	1116	1117	1138	1087	1076	1086	1136	1115	10- 20	323.3	437.3	12.4,12.4
30	978.6	1016	1042	976.7	926.1	977.7	1044	1016	20- 30	485.9	923.3	26.2,26.2
40	800.9	864.8	927.2	822.2	746.1	828.0	935.8	869.6	30- 40	576.8	1500	42.6,42.6
50	605.9	702.7	798.1	662.1	555.6	673.9	813.9	713.3	40- 50	594.1	2094	59.5,59.5
60	413.0	540.0	654.4	504.3	370.9	520.7	678.2	554.7	50- 60	544.3	2638	74.9,74.9
70	234.9	385.6	495.6	356.5	202.9	375.8	522.1	402.3	60- 70	445.3	3084	87.6,87.6
80	84.31	219.3	291.3	203.9	64.44	211.8	304.8	233.2	70- 80	303.0	3387	96.2,96.2
90	4.694	49.69	87.12	52.96	5.703	41.15	87.44	59.26	80- 90	134.9	3522	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1799.3 lm

%lum = 51.1%

%lamp = 51.1%

Conical surface Flux(130deg): 2875.9 lm

%lum = 81.7%


%lamp = 81.7%

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

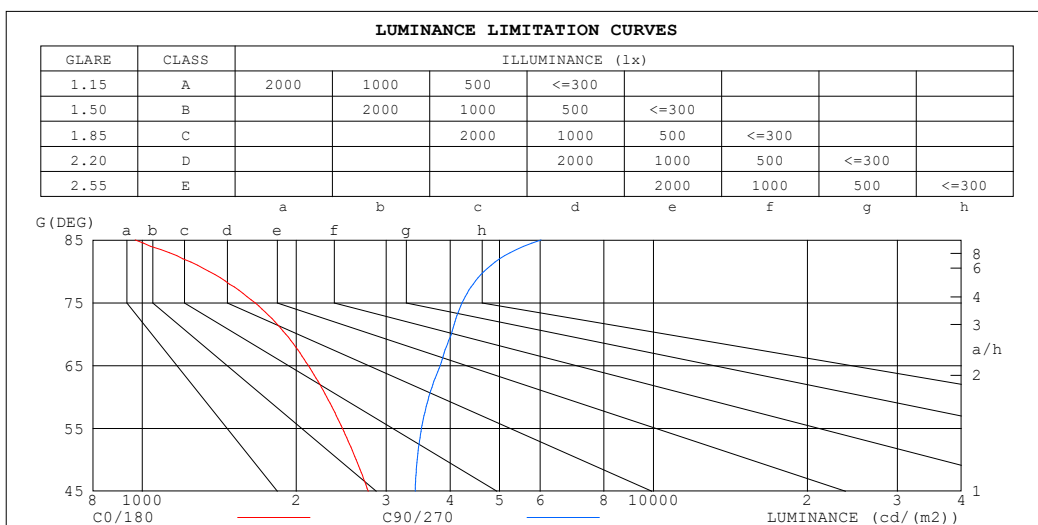

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	968	6031
80	1349	4660
75	1662	4223
70	1908	4025
65	2112	3829
60	2294	3636
55	2463	3517
50	2618	3449
45	2766	3418


H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLSN-W-2FT		
MFR.: EVERTIE		

pcc	80%			70%			50%			30%			10%			0
p _w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
p _{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

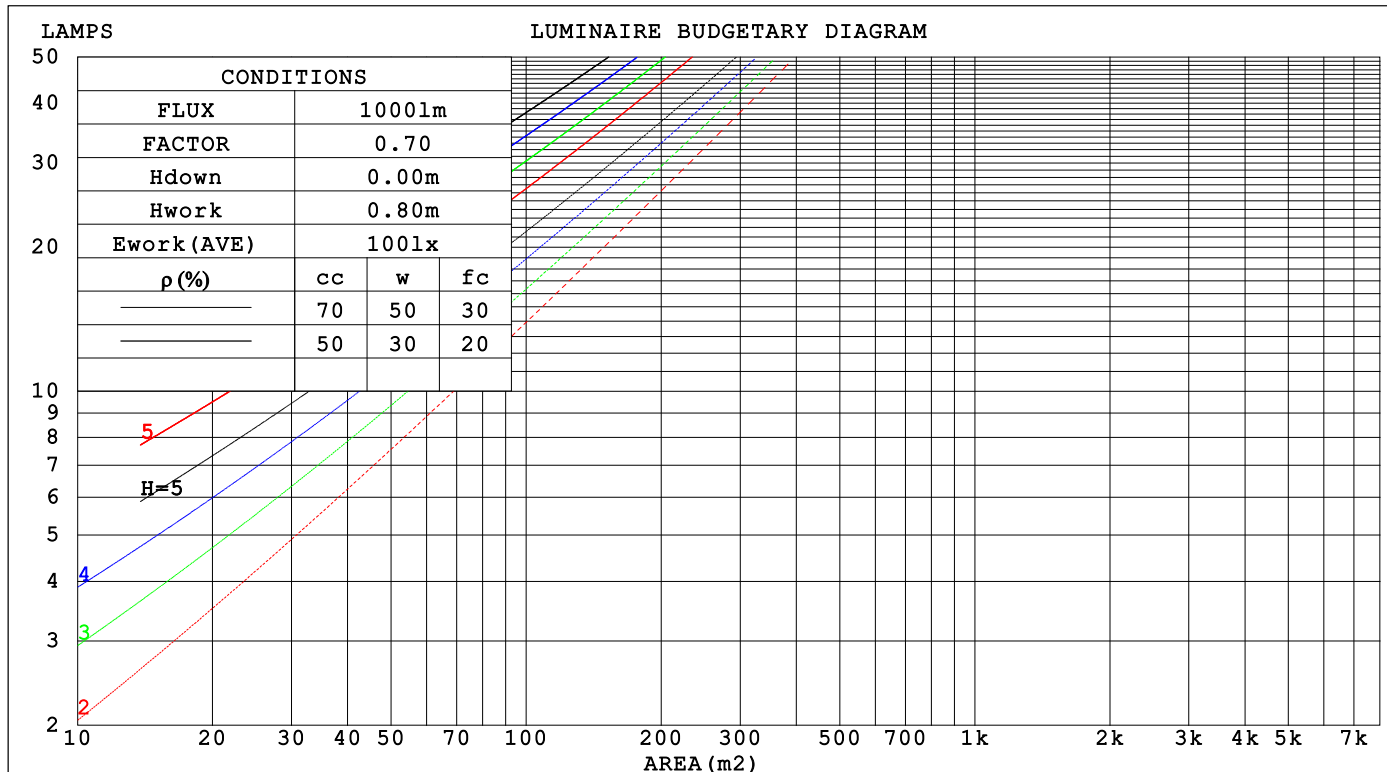

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

WEC AND CCEC

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.338	.192	.061	.331	.189	.060	.318	.182	.058	.305	.176	.057	.294	.170	.055		
2.0	.309	.169	.052	.302	.167	.051	.291	.162	.050	.280	.157	.049	.270	.152	.048		
3.0	.281	.150	.045	.276	.148	.044	.265	.144	.044	.256	.140	.043	.247	.137	.042		
4.0	.257	.134	.039	.252	.132	.039	.243	.129	.038	.234	.126	.038	.226	.123	.037		
5.0	.236	.120	.035	.232	.119	.035	.224	.116	.034	.216	.114	.034	.209	.112	.034		
6.0	.218	.109	.031	.214	.108	.031	.207	.106	.031	.200	.104	.031	.194	.102	.030		
7.0	.202	.100	.028	.199	.099	.028	.192	.097	.028	.186	.095	.028	.180	.094	.028		
8.0	.188	.092	.026	.185	.091	.026	.179	.090	.026	.174	.088	.025	.169	.087	.025		
9.0	.176	.085	.024	.173	.085	.024	.168	.083	.024	.163	.082	.023	.159	.081	.023		
10.0	.165	.079	.022	.163	.079	.022	.158	.077	.022	.154	.076	.022	.149	.075	.022		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.182	.156	.132	.156	.134	.114	.107	.092	.079	.061	.053	.046	.020	.017	.015		
2.0	.175	.132	.096	.149	.113	.083	.102	.079	.058	.059	.046	.034	.019	.015	.011		
3.0	.167	.114	.073	.143	.099	.063	.098	.069	.044	.057	.040	.026	.018	.013	.009		
4.0	.159	.101	.057	.136	.087	.050	.094	.061	.035	.054	.036	.021	.017	.012	.007		
5.0	.151	.091	.046	.130	.079	.040	.089	.055	.028	.052	.032	.017	.017	.011	.006		
6.0	.144	.082	.039	.124	.071	.034	.085	.050	.024	.049	.029	.014	.016	.010	.005		
7.0	.137	.076	.033	.118	.066	.029	.081	.046	.020	.047	.027	.012	.015	.009	.004		
8.0	.130	.070	.028	.112	.061	.025	.077	.042	.018	.045	.025	.010	.015	.008	.003		
9.0	.124	.065	.025	.107	.056	.022	.074	.040	.015	.043	.023	.009	.014	.008	.003		
10.0	.118	.060	.022	.102	.053	.019	.071	.037	.014	.041	.022	.008	.013	.007	.003		

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm										
NAME: ETLSN-W-2FT										
MFR.: EVERTIE										
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	9.4	10.9	9.7	11.1	11.4	11.4	13.0	11.7	13.2	13.4
3H	10.6	12.0	10.9	12.3	12.5	13.6	15.1	13.9	15.3	15.6
4H	11.0	12.4	11.3	12.7	12.9	14.6	16.0	15.0	16.3	16.5
6H	11.3	12.6	11.6	12.9	13.1	15.6	16.9	15.9	17.1	17.4
8H	11.3	12.6	11.7	12.9	13.2	16.0	17.2	16.3	17.5	17.8
12H	11.3	12.6	11.7	12.9	13.2	16.4	17.6	16.7	17.9	18.2
4H 2H	10.4	11.8	10.7	12.0	12.3	11.9	13.3	12.3	13.6	13.8
3H	11.8	13.0	12.2	13.3	13.7	14.4	15.6	14.7	15.9	16.2
4H	12.4	13.5	12.8	13.9	14.2	15.6	16.7	15.9	17.0	17.3
6H	12.8	13.8	13.2	14.2	14.5	16.7	17.7	17.1	18.0	18.4
8H	12.9	13.8	13.3	14.2	14.6	17.2	18.1	17.6	18.5	18.9
12H	13.0	13.8	13.4	14.2	14.6	17.7	18.6	18.1	19.0	19.4
8H 4H	13.2	14.1	13.6	14.5	14.9	15.8	16.8	16.2	17.1	17.5
6H	13.9	14.6	14.3	15.0	15.5	17.2	17.9	17.6	18.4	18.8
8H	14.1	14.8	14.6	15.2	15.7	17.8	18.5	18.3	19.0	19.4
12H	14.2	14.8	14.7	15.3	15.8	18.5	19.1	19.0	19.6	20.1
12H 4H	13.4	14.2	13.8	14.6	15.0	15.8	16.7	16.3	17.1	17.5
6H	14.2	14.9	14.6	15.3	15.7	17.2	17.9	17.7	18.4	18.8
8H	14.5	15.1	15.0	15.6	16.0	18.0	18.6	18.5	19.0	19.5
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.1 / - 0.2					+ 0.1 / - 0.1				
1.5H	+ 0.1 / - 0.2					+ 0.2 / - 0.3				
2.0H	+ 0.1 / - 0.2					+ 0.2 / - 0.3				

CIE Pub.117, 3522 lm Total Lamp Luminous Flux Correct (8log(F/F0) = 4.4)
Area: 0.36 m2

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	57	45	38	56	45	38	55	44	37	31
0.80	66	54	47	65	54	47	63	53	46	39
1.00	75	63	55	73	62	55	71	64	55	47
1.25	82	71	63	80	70	63	77	68	62	54
1.50	86	76	69	85	75	68	82	73	67	59
2.00	93	84	77	91	83	77	88	81	75	67
2.50	97	89	83	95	88	82	91	85	80	71
3.00	101	93	88	99	92	86	94	89	84	76
4.00	105	99	94	103	97	92	98	94	90	81
5.00	108	102	98	105	100	96	100	97	93	84
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

$H(\beta)$ Range:-90 - 90DEG
 $H(\beta)$ Interval: 2.0DEG
 Test Speed: HIGH
 Temperature:25.3 °C
 Operators:QUYEN
 Test Date:2026-01-21

$V(\beta)$ Range:-90 - 90DEG
 $V(\beta)$ Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
 Humidity:65.0%
 Test Distance:6.100m [K=1.0820]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

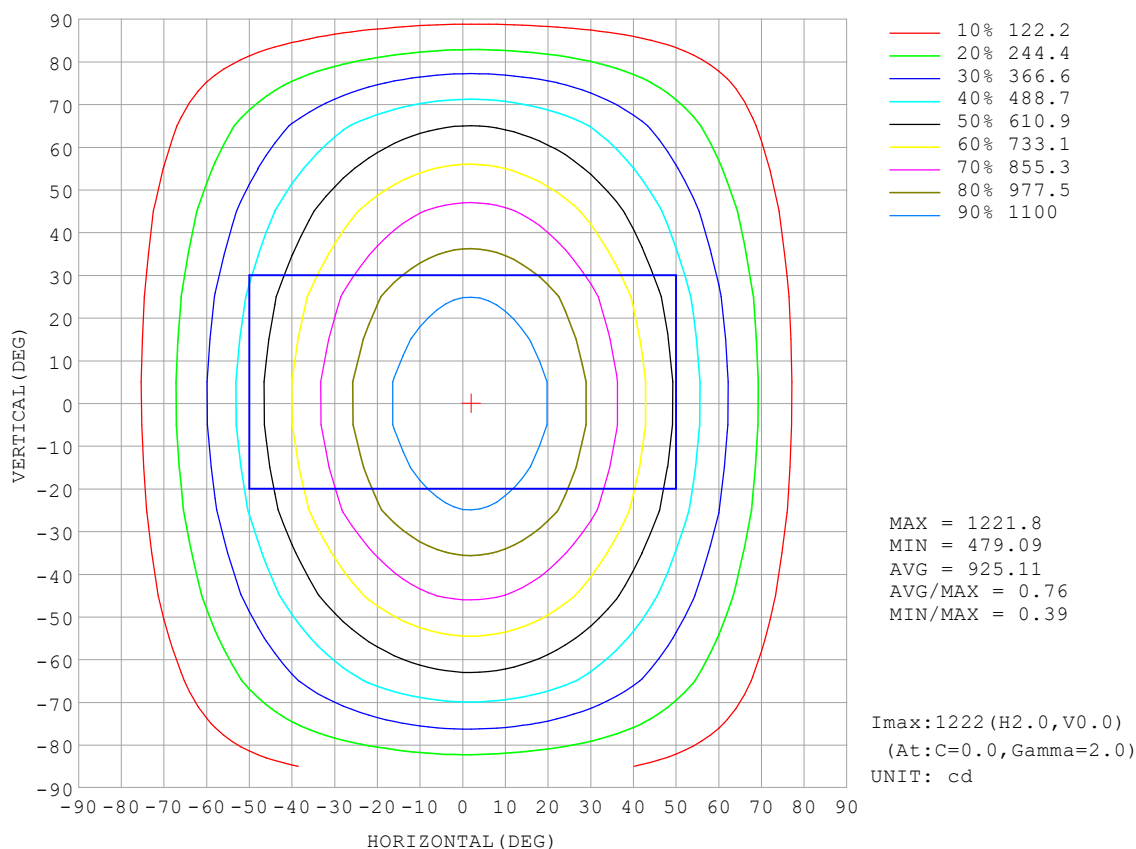


H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

AAI Figure

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLSN-W-2FT		
MFR.: EVERTIE		

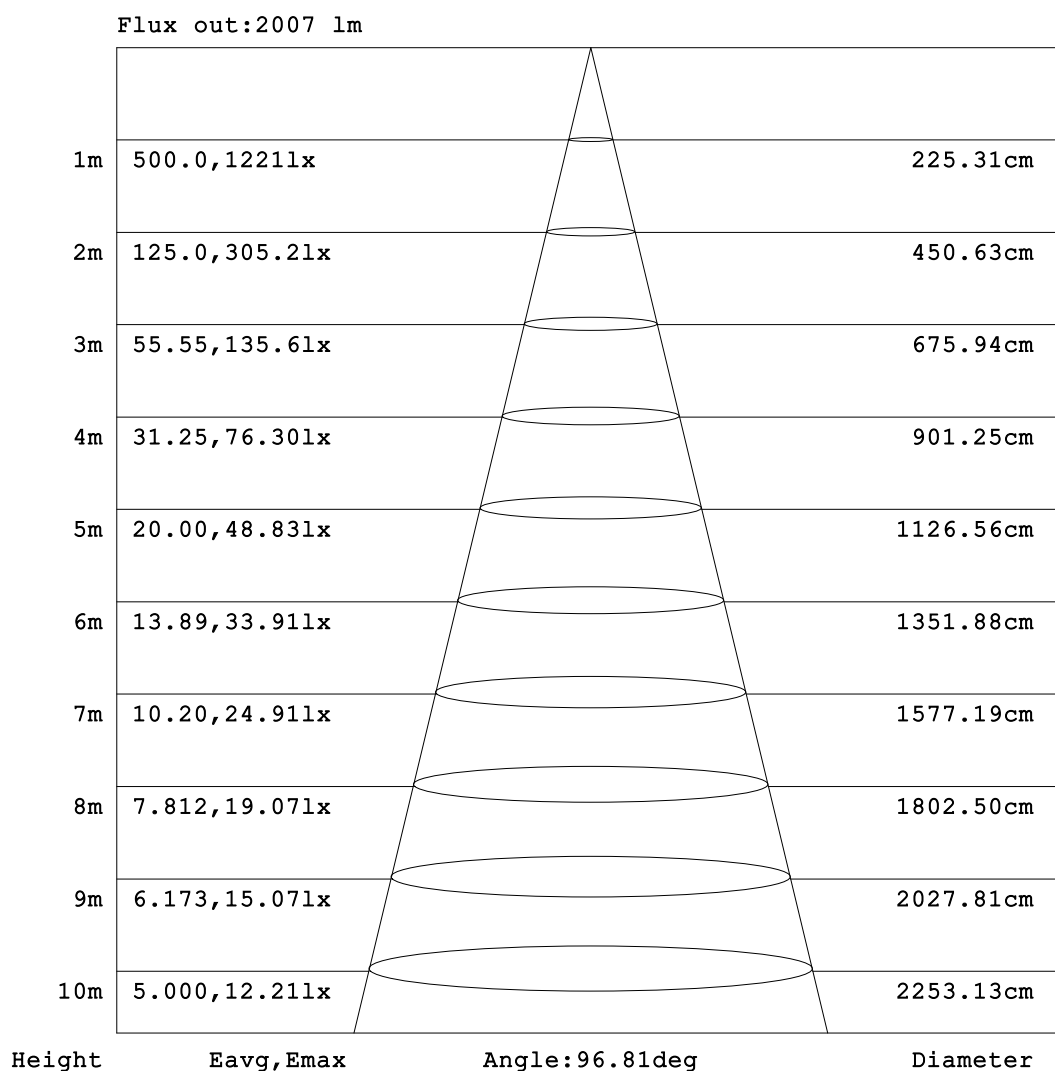


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(β) Range: -90 - 90DEG
 H(β) Interval: 2.0DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators: QUYEN
 Test Date: 2026-01-21

V(B) Range: -90 - 90DEG
 V(B) Interval: 5.0DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.489
 Humidity: 65.0%
 Test Distance: 6.100m [K=1.0820]
 Remarks:

ISOLUX DIAGRAM

Test: U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz UTHDi: 0.00% ITHDi: 0.00% KDisp: 0 Lamp Flux: 3521.68x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

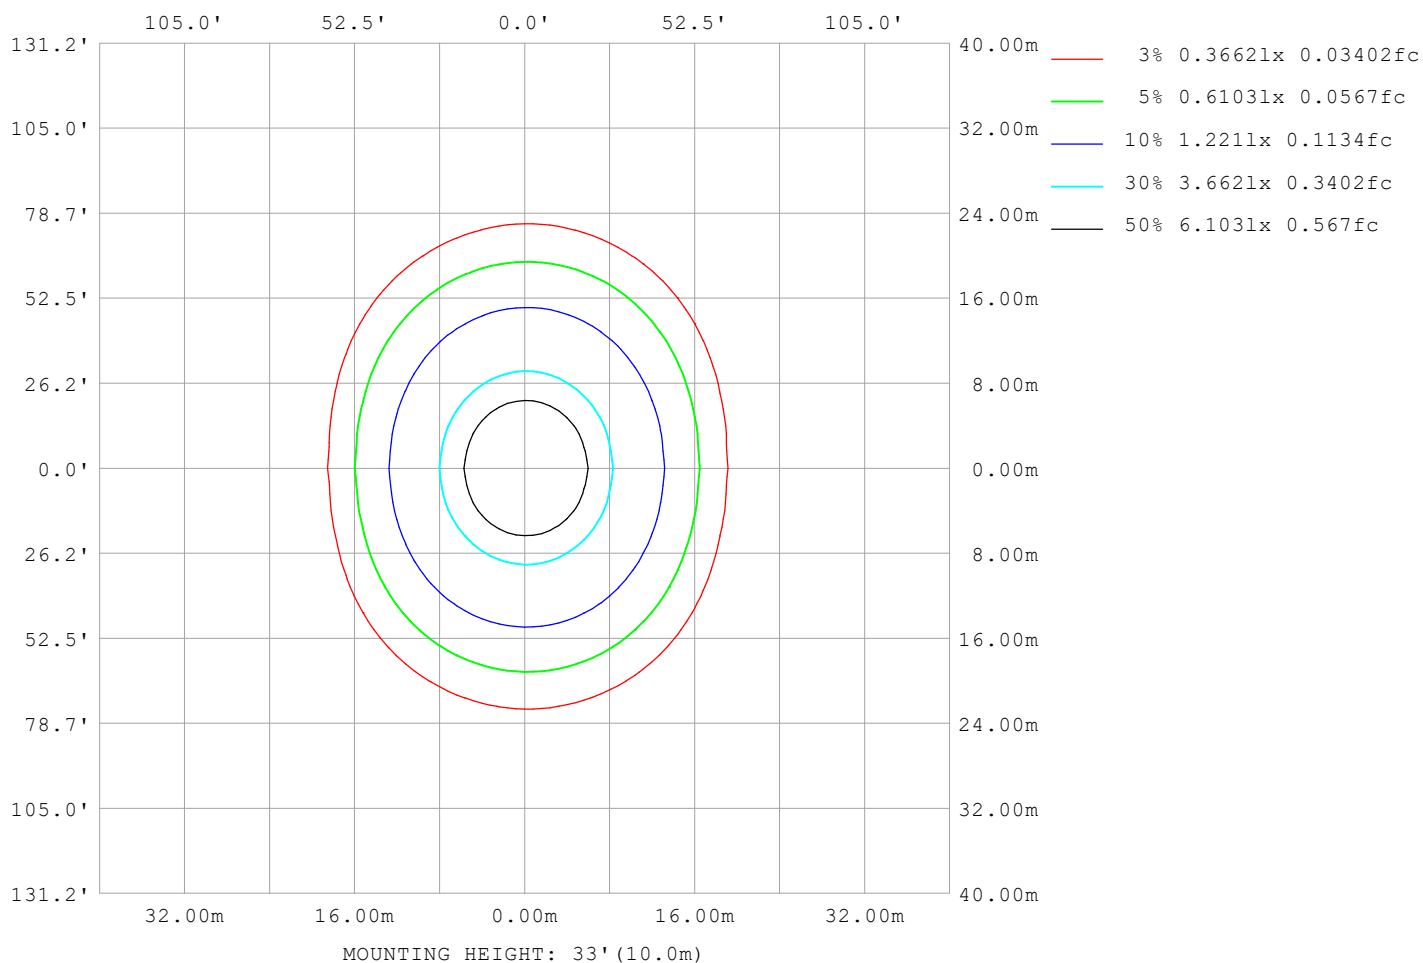

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3 °C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

LED Avg.L Report

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLSN-W-2FT		
MFR.: EVERTIE		


AvgL	cd/m2
L_0~180 (65) av	1990
L_0~180 (75) av	1519
L_0~180 (85) av	790
L_90~270 (65) av	3920
L_90~270 (75) av	4330
L_90~270 (85) av	6140
L_45 (65) av	2975
L_45 (75) av	3263
L_45 (85) av	4230

Standard: GB/T 29293-2012

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

Planar Illuminance Curve

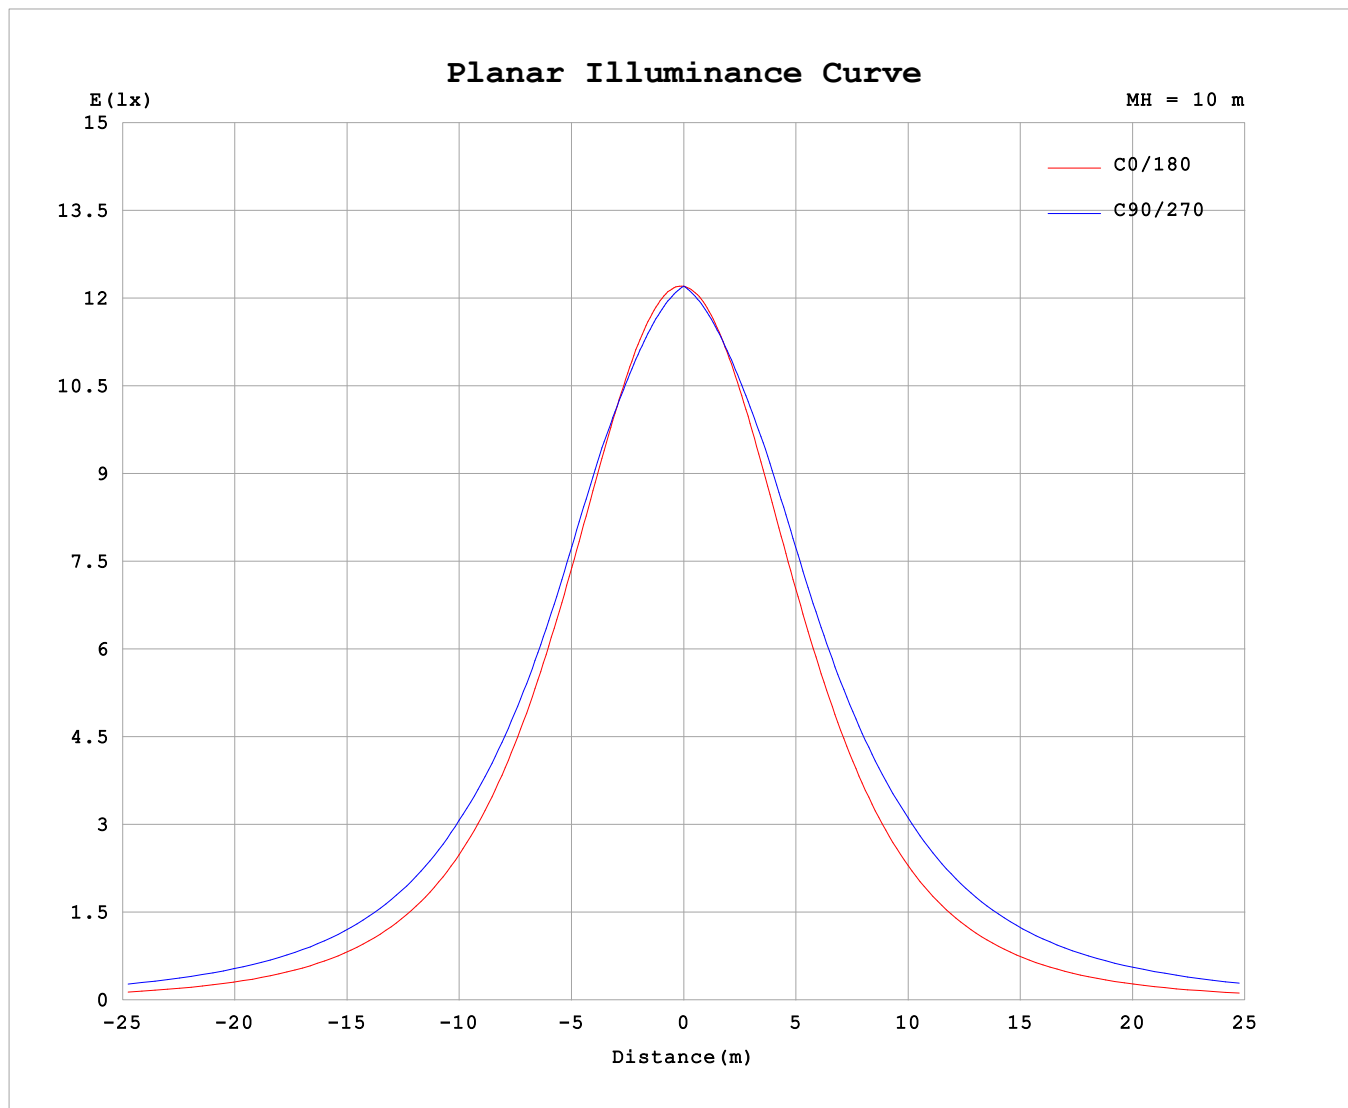

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3 °C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLSN-W-2FT		
MFR.: EVERTIE		

UNIT: cd

[illegible]

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

Test:U:121.29V I:0.1794A P:21.706W PF:0.9974 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:3521.68x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

UNIT: cd

[illegible]

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks: