


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:4333.09x1 lm		
NAME: ETLSN-W-2FT		
MFR.: EVERTIE		

DATA OF LAMP		PHOTOMETRIC DATA Eff: 164.74 lm/W			
MODEL		I _{max} (cd)	1500	S/MH(C0/180)	1.15
NOMINAL POWER(W)	26	LOR(%)	100.0	S/MH(C90/270)	1.28
RATED VOLTAGE(V)	120	TOTAL FLUX(lm)	4333.1	η UP,DN(C0-180)	0.0,49.6
NOMINAL FLUX(lm)	4333.09	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.4
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	1.25
TEST VOLTAGE(V)	120	η down (%)	100.0	CIBSE SHR MAX	1.35

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

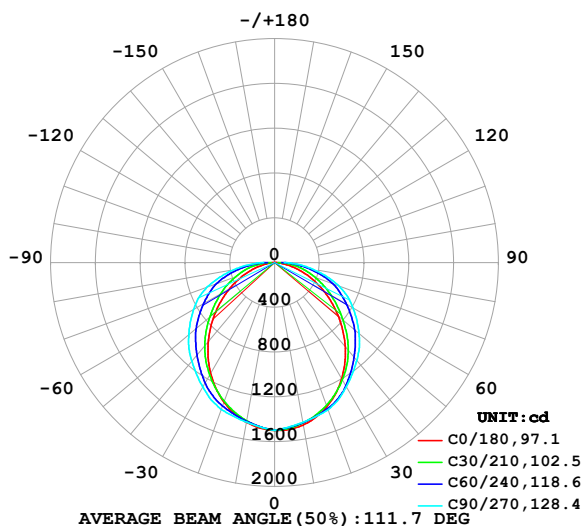

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

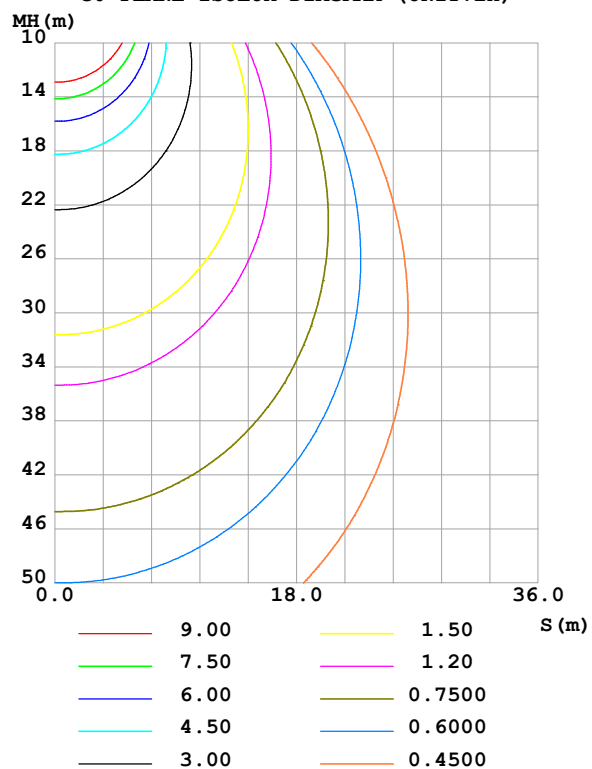

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1474	1454	1449	1436	1450	1436	1448	1452	0- 10	140.2	140.2	3.23,3.23
20	1370	1371	1399	1339	1326	1338	1396	1368	10- 20	397.5	537.6	12.4,12.4
30	1199	1248	1282	1205	1143	1205	1283	1247	20- 30	597.7	1135	26.2,26.2
40	982.5	1063	1142	1016	923.1	1022	1151	1068	30- 40	710.0	1845	42.6,42.6
50	743.4	865.2	984.7	819.8	689.1	833.2	1001	876.3	40- 50	732.1	2577	59.5,59.5
60	507.2	665.4	809.0	625.7	462.0	645.2	834.9	682.6	50- 60	671.7	3249	75,75
70	288.4	475.2	611.6	442.6	254.4	466.4	642.0	496.4	60- 70	550.4	3799	87.7,87.7
80	102.8	265.7	349.2	249.1	82.86	261.7	369.7	285.7	70- 80	373.0	4173	96.3,96.3
90	5.848	49.71	86.78	54.84	7.068	46.63	97.37	66.49	80- 90	160.6	4333	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 2214 lm

%lum = 51.1%

%lamp = 51.1%

Conical surface Flux(130deg): 3542.6 lm

%lum = 81.8%

%lamp = 81.8%

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz

UTHDi:0.00% ITHDi:0.00% KDisp:0


Lamp Flux:4333.09x1 lm

NAME: ETLSN-W-2FT

MFR.: EVERTIE

LUMINANCE LIMITATION CURVES

GLARE	CLASS	ILLUMINANCE (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

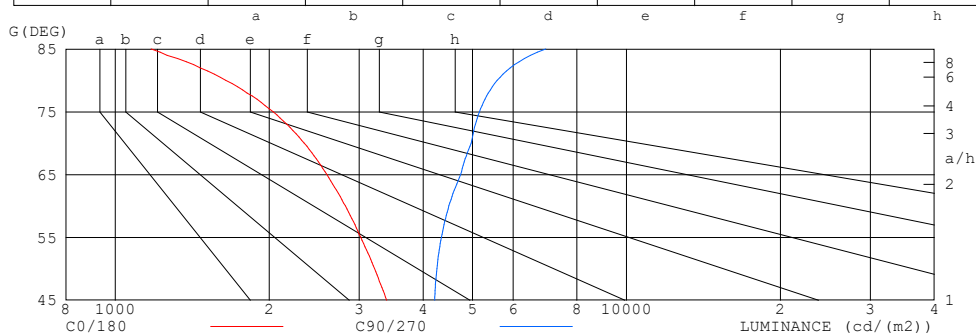

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	1176	6947
80	1644	5586
75	2036	5156
70	2342	4967
65	2593	4740
60	2818	4494
55	3021	4343
50	3212	4255
45	3394	4213


H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3 °C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:4333.09x1 lm		
NAME: ETLSN-W-2FT		
MFR.: EVERTIE		

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Coefficients of Utilization(CU)														
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00														
1.0	1.02	.98	.94	1.00	.96	.92	.96	.92	.89	.92	.89	.86	.88	.86	.84	.82														
2.0	.89	.81	.75	.87	.80	.74	.83	.78	.73	.80	.75	.71	.77	.73	.69	.67														
3.0	.78	.69	.62	.76	.68	.62	.73	.66	.61	.70	.64	.59	.68	.63	.58	.56														
4.0	.69	.59	.53	.67	.59	.52	.65	.57	.51	.62	.56	.51	.60	.55	.50	.48														
5.0	.61	.52	.45	.60	.51	.45	.58	.50	.44	.56	.49	.44	.54	.48	.43	.41														
6.0	.55	.46	.39	.54	.45	.39	.52	.45	.39	.51	.44	.38	.49	.43	.38	.36														
7.0	.50	.41	.35	.49	.41	.35	.48	.40	.34	.46	.39	.34	.45	.39	.34	.32														
8.0	.46	.37	.31	.45	.37	.31	.44	.36	.31	.42	.35	.30	.41	.35	.30	.28														
9.0	.42	.33	.28	.41	.33	.28	.40	.33	.28	.39	.32	.27	.38	.32	.27	.25														
10.0	.39	.31	.25	.38	.30	.25	.37	.30	.25	.36	.30	.25	.35	.29	.25	.23														

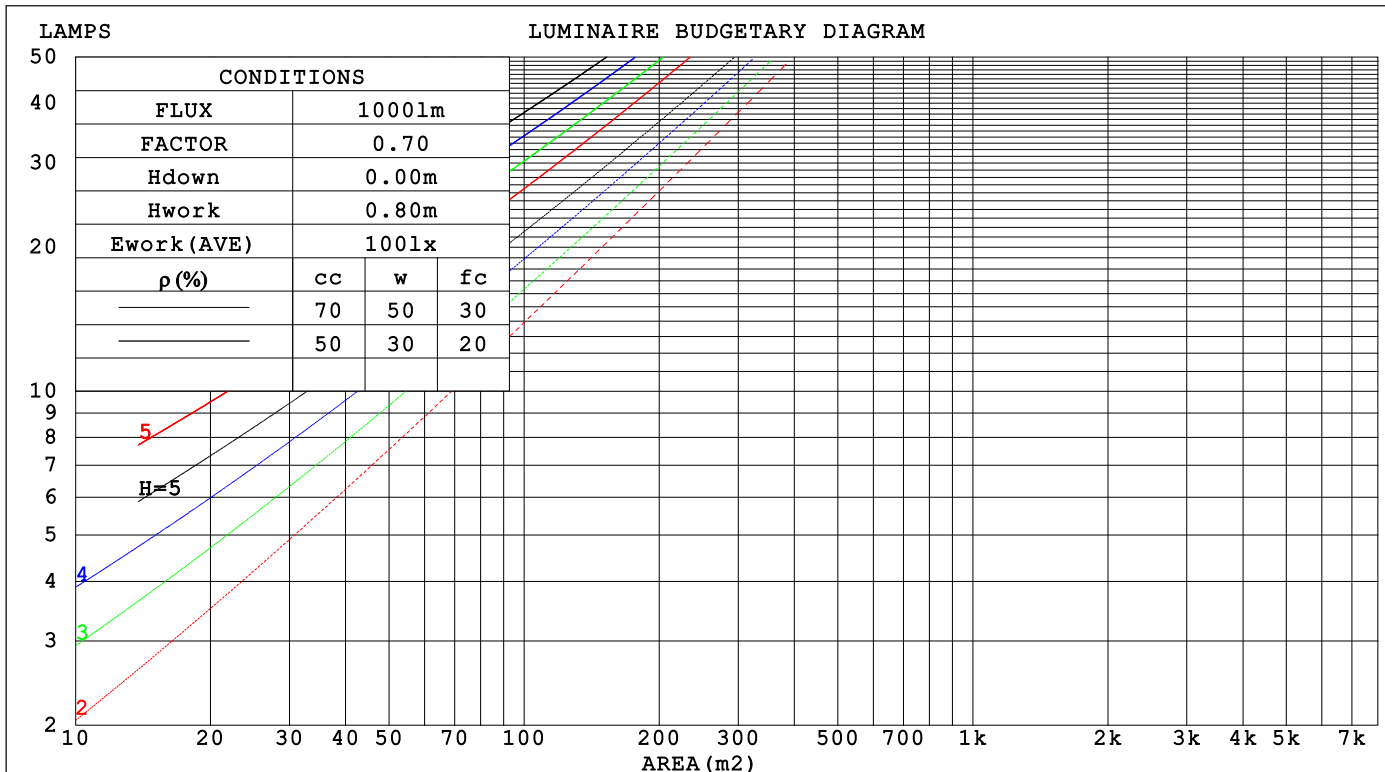

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

WEC AND CCEC

Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:4333.09x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.337	.192	.061	.330	.188	.060	.317	.182	.058	.304	.175	.056	.293	.170	.055		
2.0	.308	.169	.052	.302	.166	.051	.290	.161	.050	.279	.157	.049	.269	.152	.048		
3.0	.281	.150	.045	.276	.148	.044	.265	.144	.044	.255	.140	.043	.246	.136	.042		
4.0	.257	.134	.039	.252	.132	.039	.243	.129	.038	.234	.126	.038	.226	.123	.037		
5.0	.236	.120	.035	.232	.119	.035	.224	.116	.034	.216	.114	.034	.209	.112	.034		
6.0	.218	.109	.031	.214	.108	.031	.207	.106	.031	.200	.104	.031	.194	.102	.030		
7.0	.202	.100	.028	.199	.099	.028	.192	.097	.028	.186	.095	.028	.180	.094	.028		
8.0	.188	.092	.026	.185	.091	.026	.179	.090	.026	.174	.088	.025	.169	.087	.025		
9.0	.176	.085	.024	.173	.085	.024	.168	.083	.024	.163	.082	.023	.159	.081	.023		
10.0	.165	.079	.022	.163	.079	.022	.158	.077	.022	.154	.076	.022	.149	.075	.022		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.182	.156	.132	.156	.134	.114	.107	.092	.079	.061	.053	.046	.020	.017	.015		
2.0	.174	.132	.096	.149	.113	.083	.102	.079	.058	.059	.046	.034	.019	.015	.011		
3.0	.167	.114	.073	.143	.099	.063	.098	.069	.044	.057	.040	.026	.018	.013	.009		
4.0	.159	.101	.057	.136	.087	.050	.094	.061	.035	.054	.036	.021	.017	.012	.007		
5.0	.151	.091	.046	.130	.079	.040	.089	.055	.028	.052	.032	.017	.017	.011	.006		
6.0	.144	.082	.039	.124	.071	.034	.085	.050	.024	.049	.029	.014	.016	.010	.005		
7.0	.137	.076	.033	.118	.066	.029	.081	.046	.020	.047	.027	.012	.015	.009	.004		
8.0	.130	.070	.028	.112	.061	.025	.077	.042	.018	.045	.025	.010	.015	.008	.003		
9.0	.124	.065	.025	.107	.056	.022	.074	.040	.015	.043	.023	.009	.014	.008	.003		
10.0	.118	.060	.022	.102	.053	.019	.071	.037	.014	.041	.022	.008	.013	.007	.003		

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:4333.09x1 lm										
NAME: ETLSN-W-2FT										
MFR.: EVERTIE										
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	9.4	10.9	9.7	11.1	11.4	11.5	13.0	11.7	13.2	13.4
3H	10.6	12.0	10.9	12.3	12.5	13.6	15.1	13.9	15.3	15.6
4H	11.0	12.4	11.3	12.7	12.9	14.6	16.0	15.0	16.3	16.5
6H	11.3	12.6	11.6	12.9	13.1	15.5	16.8	15.9	17.1	17.4
8H	11.3	12.6	11.7	12.9	13.2	15.9	17.2	16.3	17.5	17.8
12H	11.3	12.6	11.7	12.9	13.2	16.3	17.5	16.6	17.8	18.1
4H 2H	10.4	11.8	10.7	12.0	12.3	12.0	13.3	12.3	13.6	13.9
3H	11.8	13.1	12.2	13.3	13.7	14.4	15.6	14.7	15.9	16.2
4H	12.4	13.5	12.8	13.9	14.2	15.6	16.7	15.9	17.0	17.3
6H	12.8	13.8	13.2	14.2	14.5	16.6	17.6	17.0	18.0	18.4
8H	12.9	13.8	13.3	14.2	14.6	17.1	18.1	17.5	18.4	18.8
12H	12.9	13.8	13.4	14.2	14.6	17.6	18.5	18.0	18.8	19.2
8H 4H	13.2	14.1	13.6	14.5	14.9	15.8	16.7	16.2	17.1	17.5
6H	13.8	14.6	14.3	15.0	15.5	17.1	17.9	17.6	18.3	18.7
8H	14.1	14.8	14.5	15.2	15.7	17.8	18.4	18.2	18.9	19.3
12H	14.2	14.8	14.7	15.3	15.7	18.4	19.0	18.9	19.4	19.9
12H 4H	13.3	14.2	13.8	14.6	15.0	15.8	16.7	16.2	17.1	17.5
6H	14.1	14.8	14.6	15.3	15.7	17.2	17.9	17.6	18.3	18.8
8H	14.5	15.1	14.9	15.5	16.0	17.9	18.5	18.4	18.9	19.4
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.1 / - 0.2					+ 0.1 / - 0.1				
1.5H	+ 0.1 / - 0.2					+ 0.2 / - 0.3				
2.0H	+ 0.1 / - 0.2					+ 0.2 / - 0.3				

CIE Pub.117, 4333 lm Total Lamp Luminous Flux Correct (8log(F/F0) = 5.1)
Area: 0.36 m2

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:4333.09x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	57	45	38	56	45	38	55	44	37	31
0.80	66	54	47	65	54	47	63	53	46	39
1.00	75	63	55	73	62	55	71	64	55	47
1.25	82	71	63	80	70	63	77	68	62	54
1.50	87	76	69	85	75	68	82	73	67	59
2.00	93	84	78	92	83	77	88	81	75	67
2.50	97	89	83	95	88	82	91	85	80	71
3.00	101	94	88	99	92	87	95	89	84	76
4.00	105	99	94	103	97	92	98	94	90	81
5.00	108	102	98	105	100	96	101	97	93	84
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

$H(\beta)$ Range:-90 - 90DEG
 $H(\beta)$ Interval: 2.0DEG
 Test Speed: HIGH
 Temperature:25.3°C
 Operators:QUYEN
 Test Date:2026-01-21

$V(\beta)$ Range:-90 - 90DEG
 $V(\beta)$ Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
 Humidity:65.0%
 Test Distance:6.100m [K=1.0820]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:4333.09x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

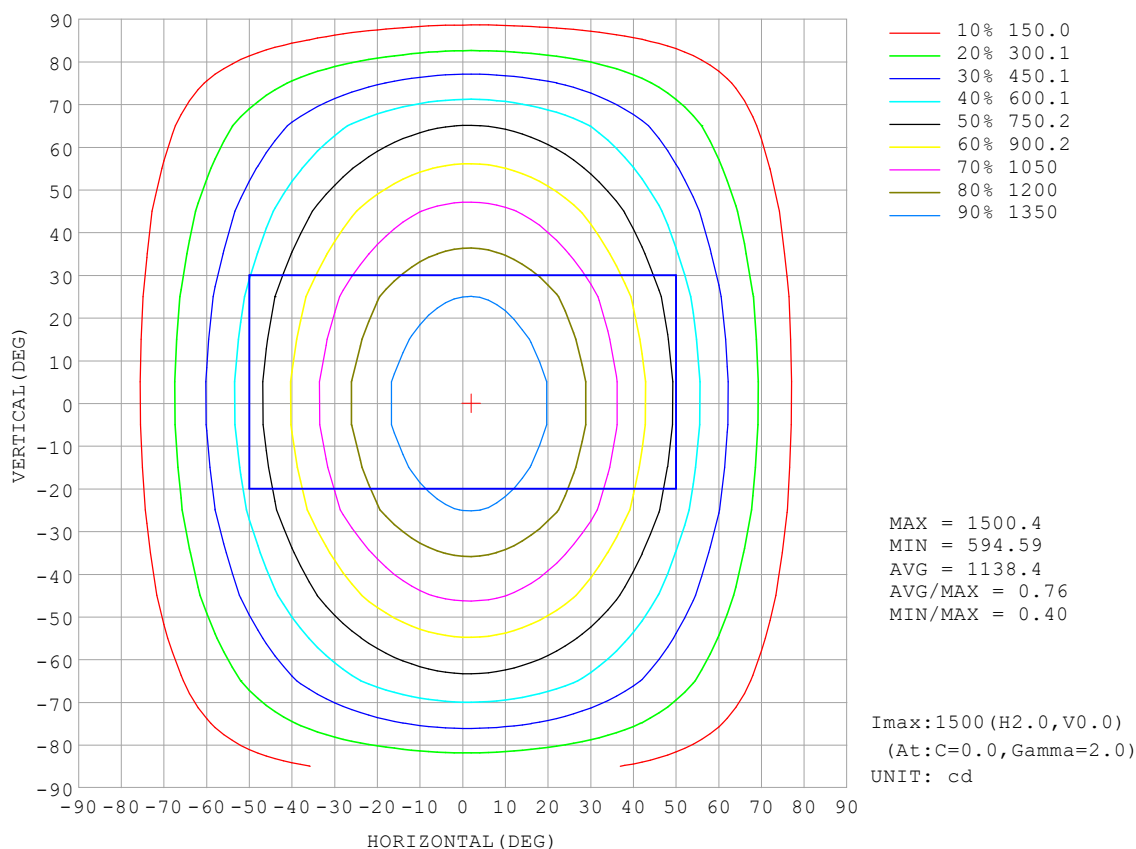


H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

AAI Figure

Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:4333.09x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

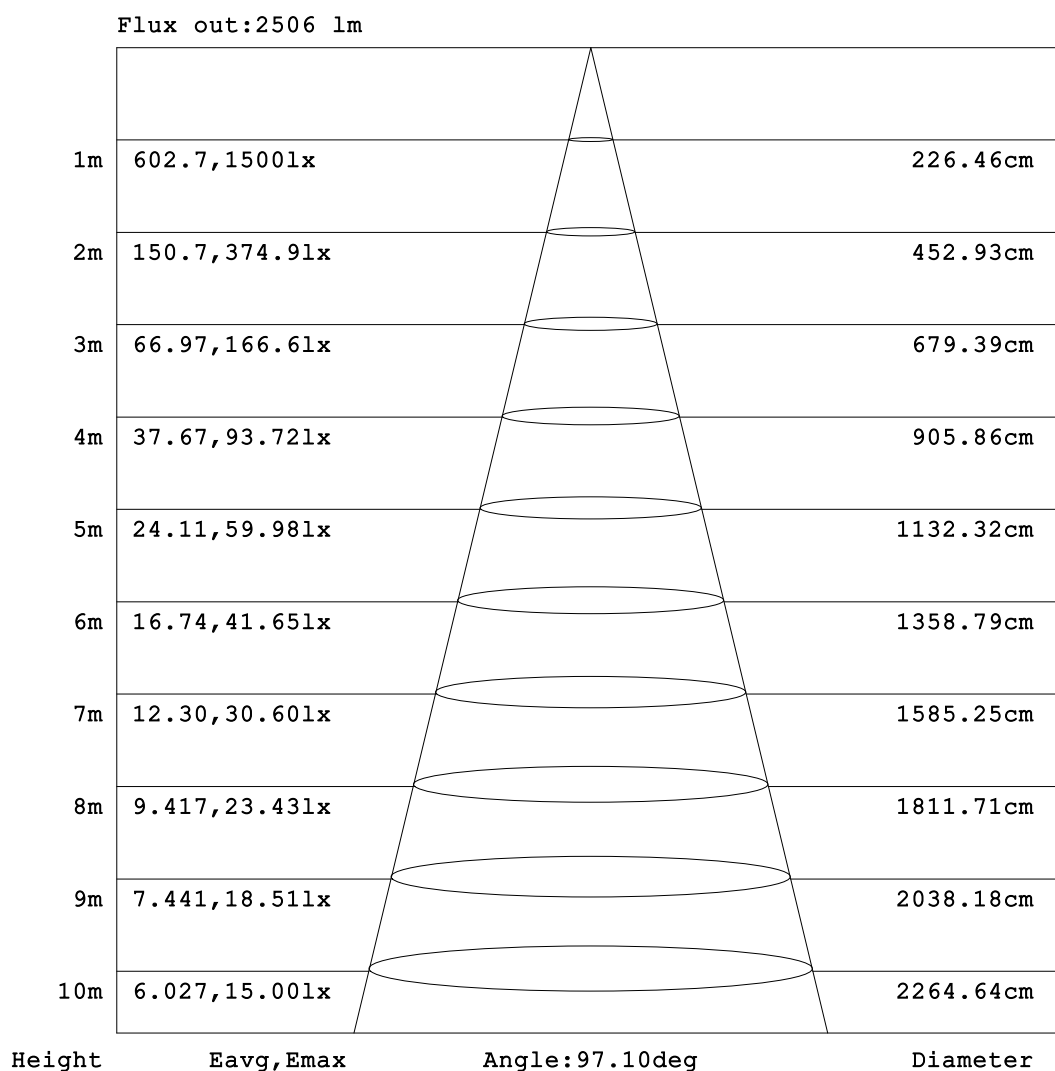


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H(β) Range:-90 - 90DEG
 H(β) Interval: 2.0DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:QUYEN
 Test Date:2026-01-21

V(B) Range:-90 - 90DEG
 V(B) Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
 Humidity:65.0%
 Test Distance:6.100m [K=1.0820]
 Remarks:

ISOLUX DIAGRAM

Test: U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz UTHDi: 0.00% ITHDi: 0.00% KDisp: 0 Lamp Flux: 4333.09x1 lm		
NAME: ETLN-W-2FT		
MFR.: EVERTIE		

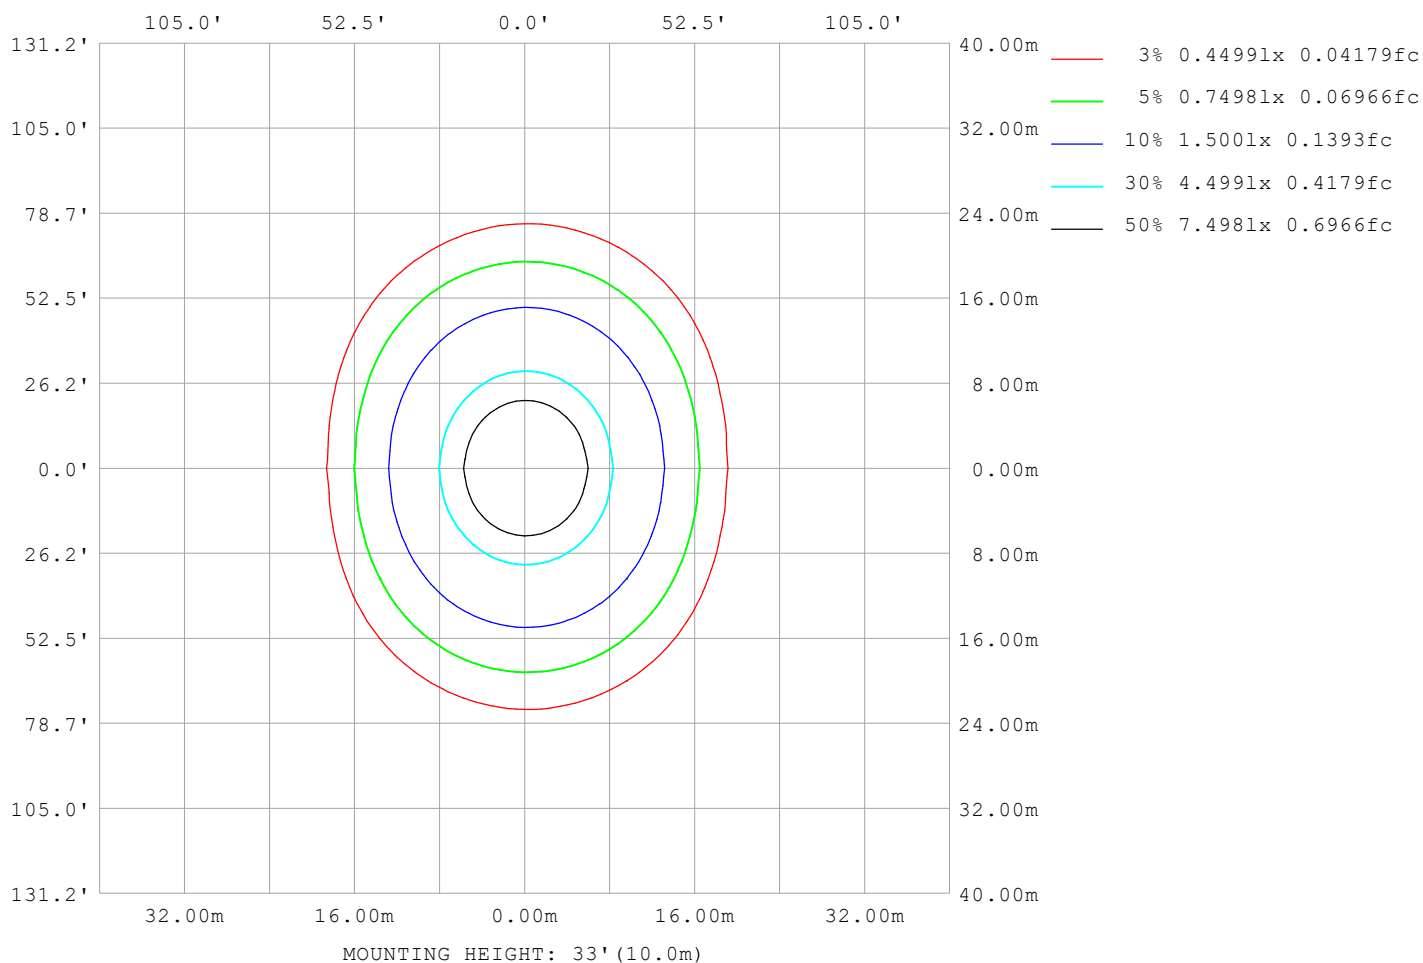

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3 °C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

LED Avg.L Report

Test:U:121.26V I:0.2172A P:26.302W PF:0.9985 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:4333.09x1 lm		
NAME: ETLSN-W-2FT		
MFR.: EVERTIE		


AvgL	cd/m2
L_0~180 (65) av	2464
L_0~180 (75) av	1889
L_0~180 (85) av	996
L_90~270 (65) av	4840
L_90~270 (75) av	5292
L_90~270 (85) av	7195
L_45 (65) av	3678
L_45 (75) av	4031
L_45 (85) av	5052

Standard: GB/T 29293-2012

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

Planar Illuminance Curve

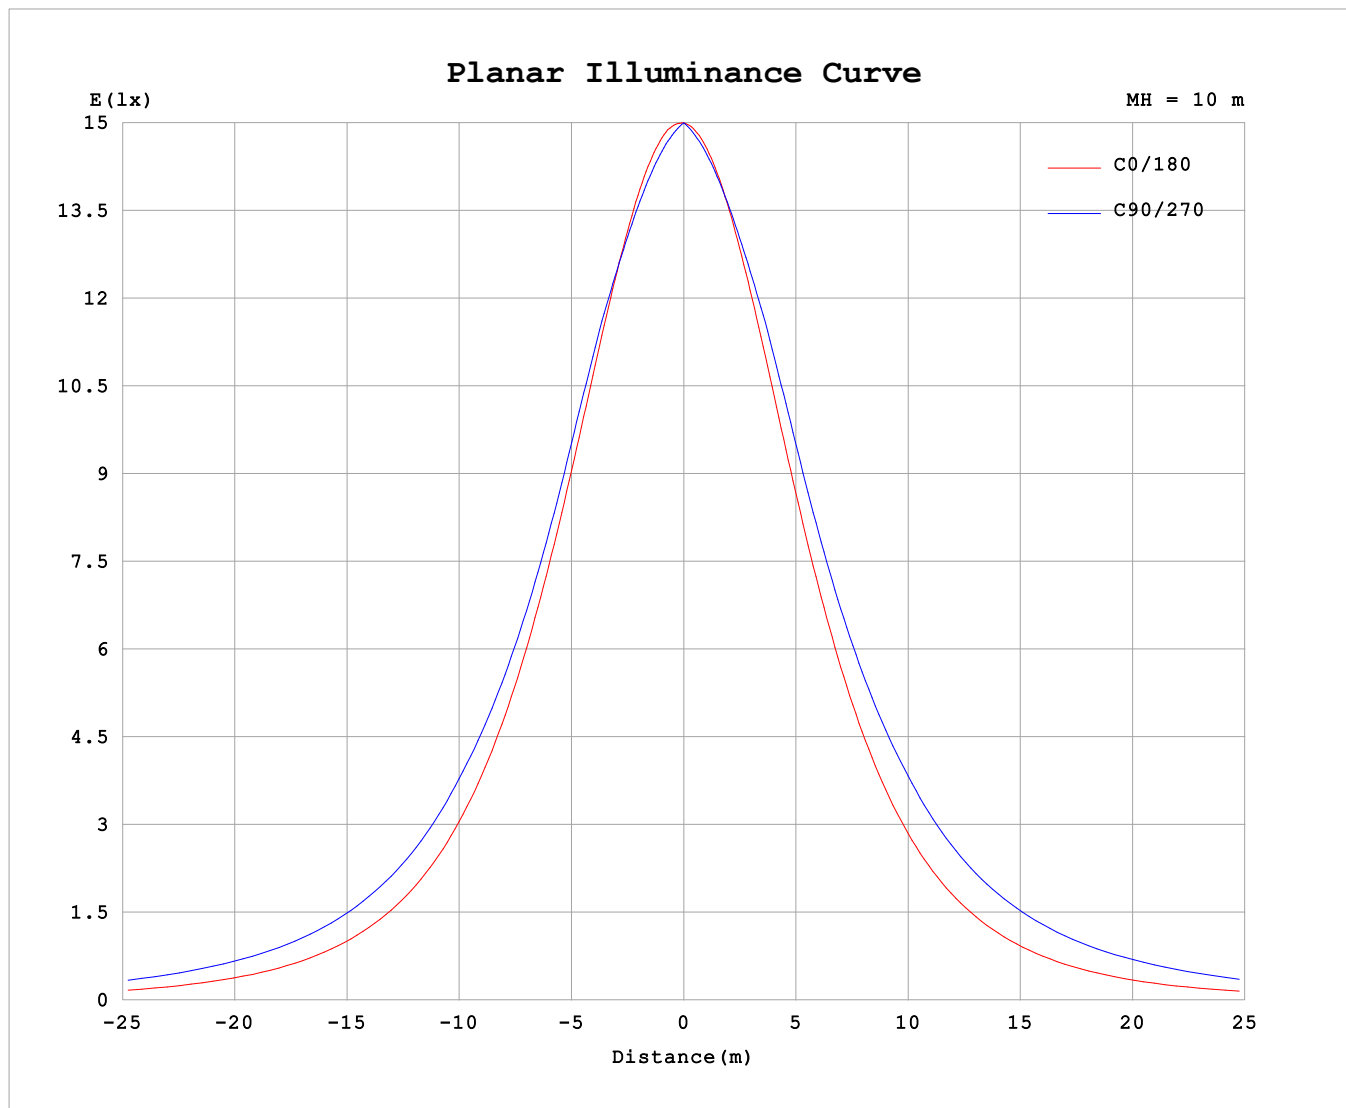

H(β) Range:-90 - 90DEG
H(β) Interval: 2.0DEG
Test Speed: HIGH
Temperature:25.3 °C
Operators:QUYEN
Test Date:2026-01-21

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks:

V(B) Range:-90 - 90DEG
V(B) Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.489
Humidity:65.0%
Test Distance:6.100m [K=1.0820]
Remarks: